


POOL GAS ELECTRICAL AND COMMUNICATIONS

DRAFT

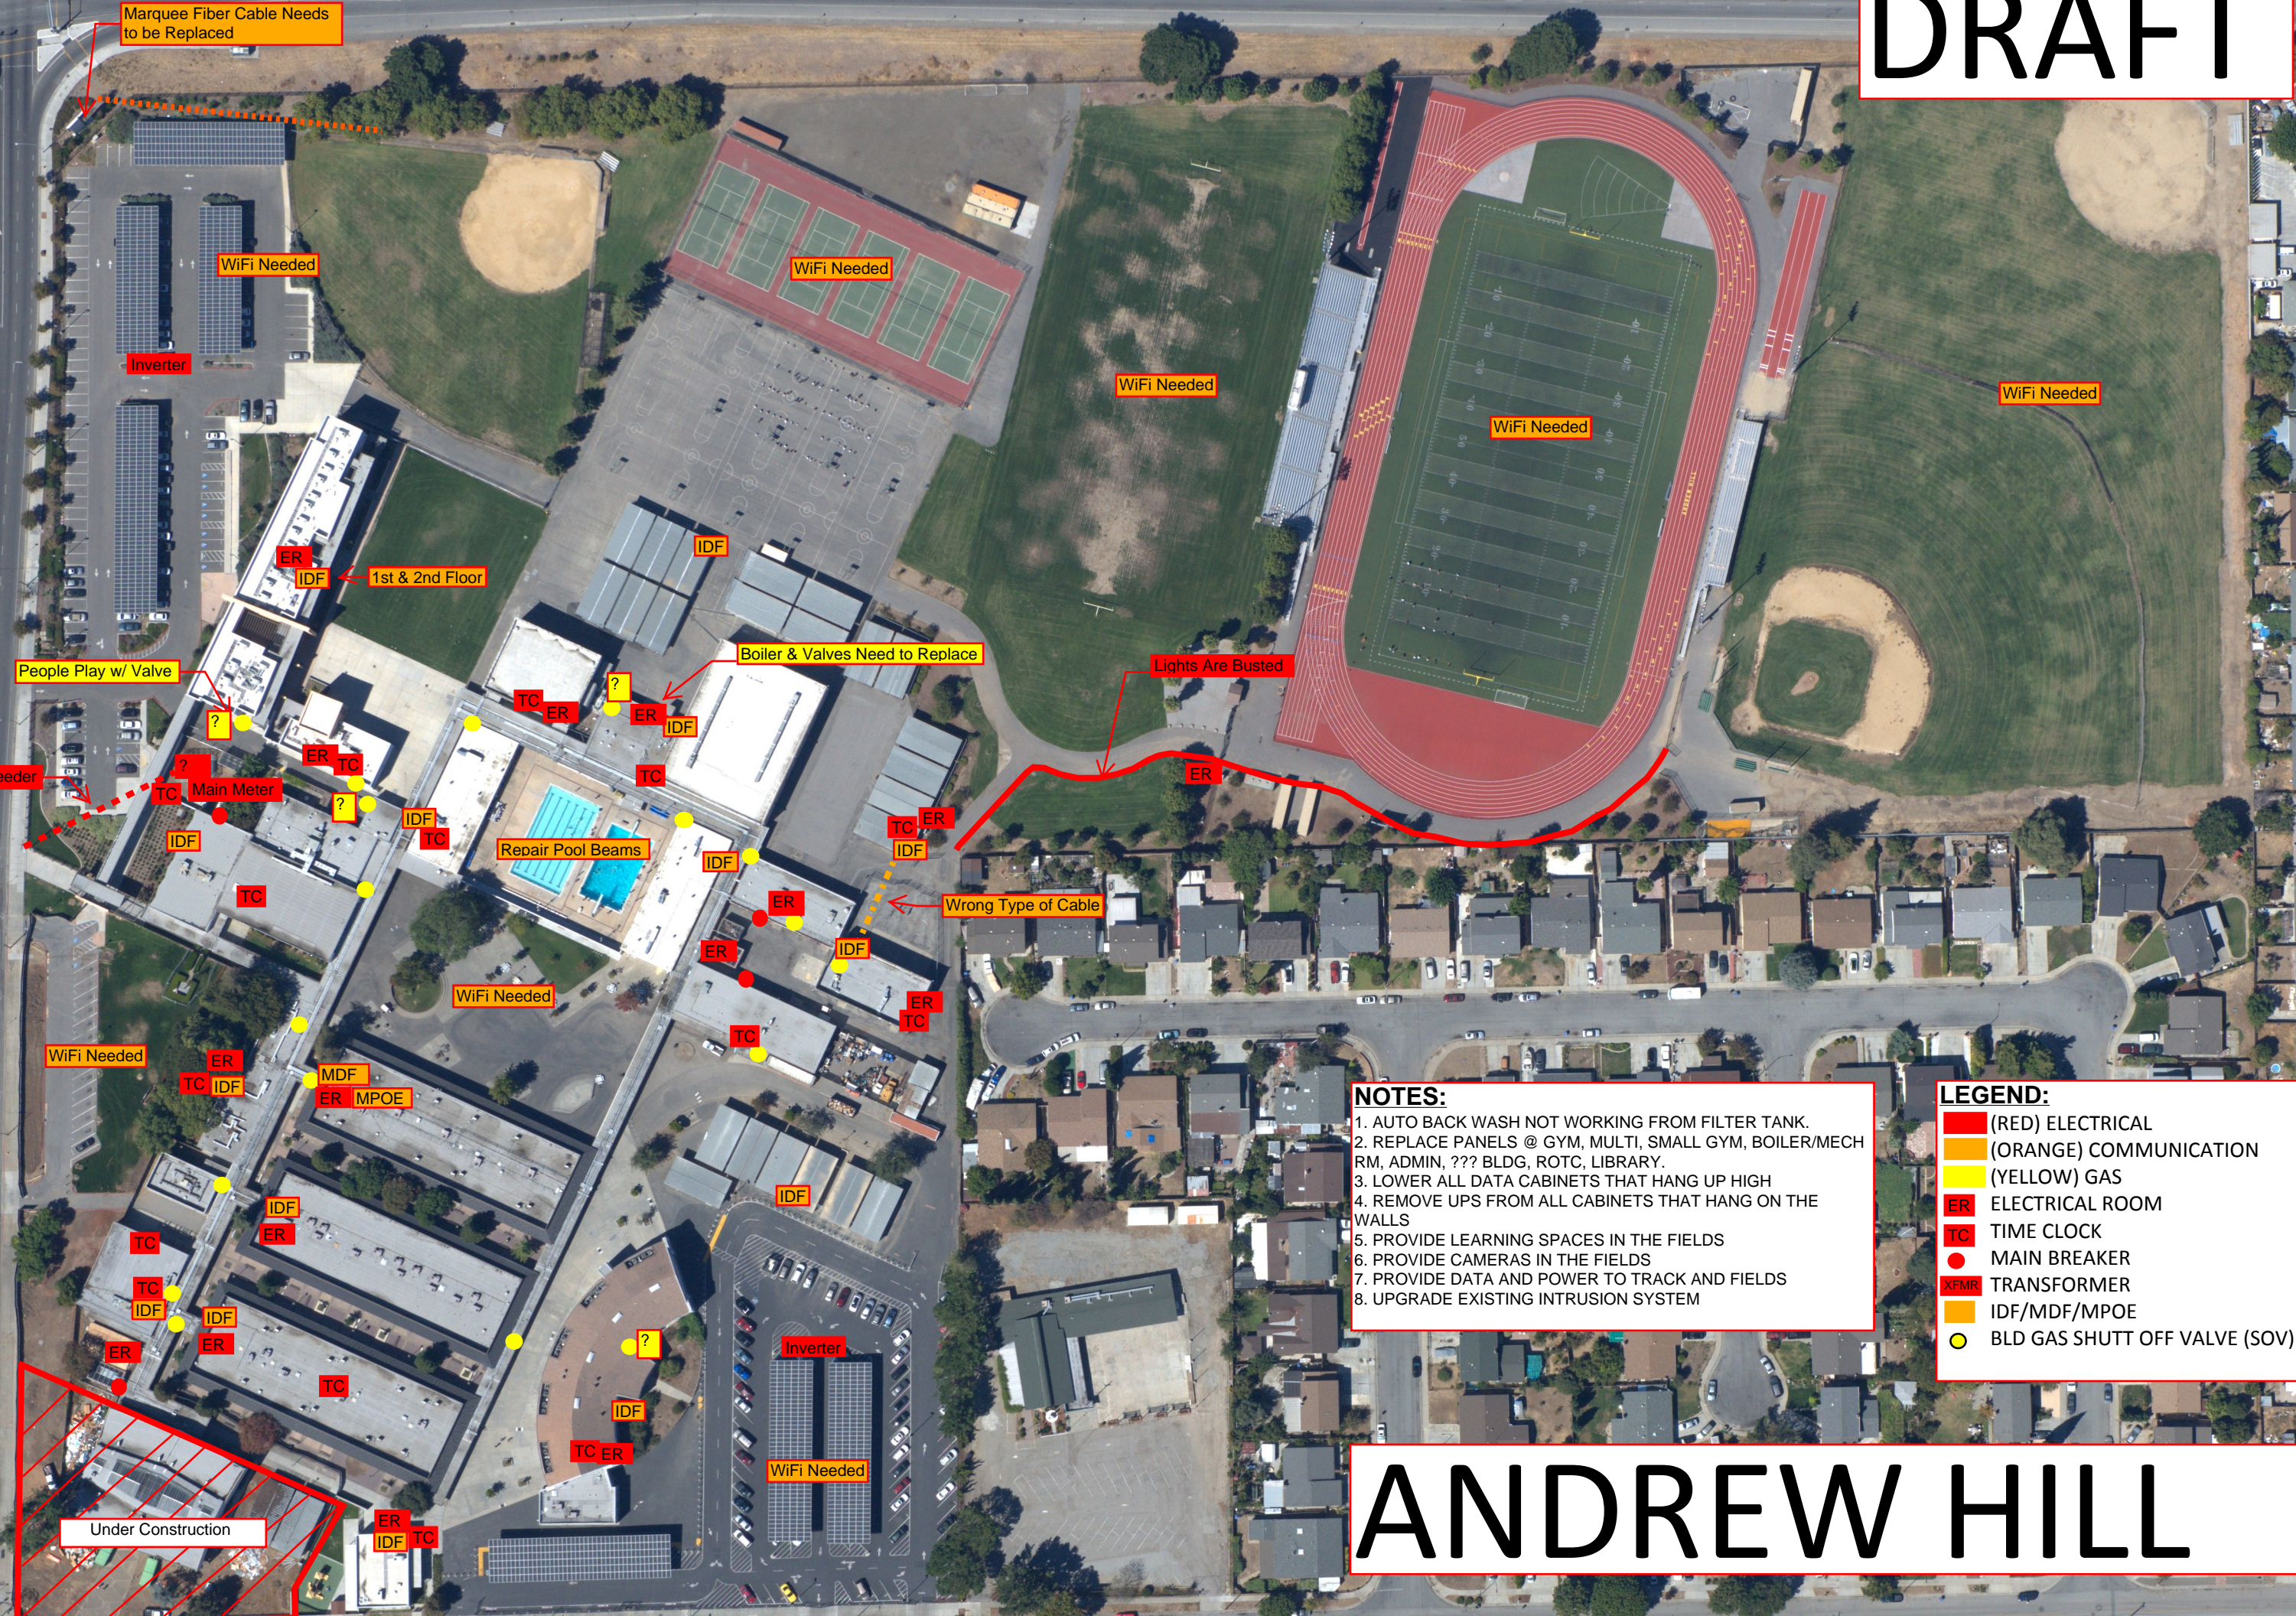

- NOTES:**
- 1. AUTO BACK WASH NOT WORKING FROM FILTER TANK.
 - 2. REPLACE PANELS @ GYM, MULTI, SMALL GYM, BOILER/MECH RM, ADMIN, ??? BLDG, ROTC, LIBRARY.
 - 3. LOWER ALL DATA CABINETS THAT HANG UP HIGH
 - 4. REMOVE UPS FROM ALL CABINETS THAT HANG ON THE WALLS
 - 5. PROVIDE LEARNING SPACES IN THE FIELDS
 - 6. PROVIDE CAMERAS IN THE FIELDS
 - 7. PROVIDE DATA AND POWER TO TRACK AND FIELDS
 - 8. UPGRADE EXISTING INTRUSION SYSTEM

- LEGEND:**
- (RED) ELECTRICAL
 - (ORANGE) COMMUNICATION
 - (YELLOW) GAS
 - ER ELECTRICAL ROOM
 - TC TIME CLOCK
 - MAIN BREAKER
 - XPMR TRANSFORMER
 - IDF/MDF/MPOE
 - BLD GAS SHUTT OFF VALVE (SOV)

ANDREW HILL